

14515 Pioneer Way E
Puyallup WA 98372
(253)841-9698
www.valleywaterdistrict.com
Email: service@valleywaterdistrict.com
Sean Vance, District Manager
Brian Thompson, Operations Manager

Drinking Water Quality Report for Valley Water System Pierce County Water System ID #01250 2025

In this report, you will find information about:

- YOUR WATER**
 - Your Water System
 - Arsenic Information
 - Source Water Protection
 - Cross-Connection Control
- TEST RESULTS**
 - Possible Contaminants
 - Key Table Definitions
 - Lead Information
 - Water Quality Table
 - Tacoma Water Quality Table

WHERE DOES MY WATER COME FROM?

The water source for this system is a well in the Puyallup Valley. The well is 300 feet deep and can pump 800 gallons per minute.

OTHER SOURCE RESULTS:

An intertie with Tacoma Water on the Valley Water System is used to provide supplemental water during times of high demand, power outages, and during fire flow conditions. The last page of this report contains the water quality monitoring information provided to us by Tacoma Water.

HOW IS MY WATER TREATED?

Your water is treated by disinfection which involves the addition of chlorine or other disinfectant to kill dangerous bacteria and microorganisms that may be in the water. Disinfection is considered to be one of the major public health advances of the 20th century.

INFORMATION ABOUT ARSENIC:

While your drinking water meets EPA's standard for arsenic, it does contain low levels of arsenic. EPA's standard balances the current understanding of arsenic's possible health effects against the costs of removing arsenic from drinking water. EPA continues to research the health effects of low levels of arsenic which is a mineral known to cause cancer in humans at high concentrations and is linked to other health effects such as skin damage and circulatory problems.

We are proud to report that this system meets all state and federal guidelines for regulated contaminants, and is significantly below the EPA's required safety levels.

Water Quality Report Information



Valley Water District is pleased to present this year's Annual Water Quality Report (Consumer Confidence Report) as required by the Safe Drinking Water Act (SDWA). This report is designed to provide details about where your water comes from, what it contains, and how it compares to standards set by regulatory agencies. We are committed to providing you with information because informed customers are our best allies.

Valley Water District vigilantly safeguards and routinely monitors your drinking water. We are providing this report as a snapshot of water quality monitoring for the calendar year of the report (unless otherwise noted). The EPA or the State requires us to monitor for certain contaminants less than once per year because the concentrations of these contaminants do not vary significantly from year to year, or the system is not considered vulnerable to this type of contamination. As such, some of our data, though representative, may be more than one year old.

How Can I Get Involved?


We want our valued customers to be informed about their water utility. If you would like to learn more, please attend any regularly scheduled Board Meeting held at the District Office on the first and third Tuesday of each month, at 2:00pm.

Questions?

If you have any questions about the information in this report, or any concern regarding water quality and the services we deliver every day, please contact the District office at 253-841-9698.

Sean Vance, District Manager ~ Brian Thompson, Operations Manager ~ Email: service@valleywaterdistrict.com

Visit www.epa.gov/watersense/start—saving for great water saving tips!

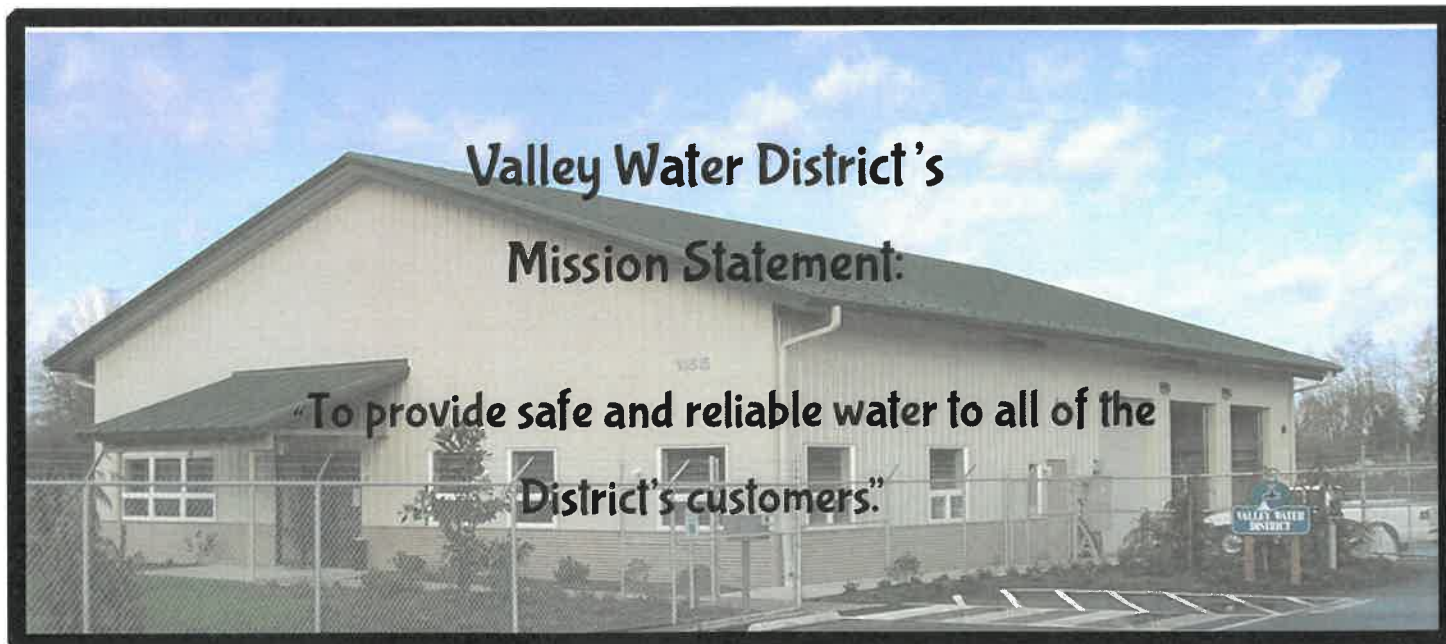

Possible Contaminants

Common sources of drinking water- tap water from a water system or bottled water - include rivers, lakes, streams, ponds, springs, and reservoirs (surface water), and wells and springs (groundwater).

As water travels over the surface of the land or through the ground, naturally occurring minerals and, in some cases, radioactive materials dissolve in the water.

Water can also pick up substances resulting from the presence of animals or human activity.

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk.

More information about contaminants and potential health effects can be obtained by calling EPA's Safe Drinking Water Hotline (1-800-426-4791).

Contaminants that may be present in source water include:

Microbial contaminants, such as viruses, parasites, and bacteria that may come from sewage treatment plants, septic systems, agricultural livestock operations, or wildlife.

Inorganic contaminants, such as salts and metals, which can occur naturally or result from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining, and farming.

Pesticides and herbicides, which may come from various sources such as agriculture, urban stormwater runoff, and residential uses.

Organic Chemical Contaminants, including synthetic and volatile organic chemicals which are by-products of industrial processes and petroleum production. They can also come from gas stations, urban stormwater runoff, and septic systems.

Radioactive Contaminants, which can occur naturally or result from oil and gas production and mining activities.

In order to ensure that tap water is safe to drink, EPA prescribes regulations that limit the amount of certain contaminants in water provided by public water systems. Food and Drug Administration (FDA) regulations establish limits for contaminants in bottled water which must provide the same protection for public health.

VULNERABLE POPULATIONS: Some people may be more vulnerable to contaminants in drinking water than the general population. Immunocompromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. EPA/CDC guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the Safe Drinking Water Hotline (1-800-426-4791).

PFAS or "Forever Chemicals" Testing

Many of you have likely seen the news articles or television news stories about the "Forever Chemicals" that may be in the Public Water Systems. The chemicals known as PFAS or PFOA have been detected in many water systems in Washington State. The EPA and Department of Health have established rules for testing and treatment.

The District is happy to announce that we have conducted testing for these contaminants and there was NO DETECTION in any of Valley Water District's water sources. We will continue to test as required by Department of Health and keep you informed of results in the future.

For additional information on PFAS and related contaminants please go to www.doh.wa.gov/community-and-environment/contaminants/pfas

Cross-Connection Control Survey

A cross connection is an unprotected or improper connection to a public water distribution system that may cause contamination or pollution to enter the system.

Valley Water District is responsible for enforcing cross-connection control regulations and ensuring that no contaminants can, under any flow conditions, enter the distribution system.

If you have any of the devices listed below, please contact us so that we can discuss the issue, and if needed, survey your connection and assist you in isolating it if that is necessary.



Do you have one of these at your home or business?

- Lawn irrigation system
- Pool or hot tub
- Decorative pond or fountain
- Watering trough
- Fire sprinkler system
- Additional source(s) of water on the property



If you do, Washington State law may require that you have a “Backflow Prevention Assembly”. The purpose of this device is to provide “cross connection control” - preventing contaminated water from flowing back into your drinking water - a serious health hazard.

However, even the best Backflow Prevention Assembly can fail because of freezing, debris, improper installation and unapproved plumbing connections. For this reason, the state’s Department of Health requires these devices to be tested annually by a certified backflow assembly tester, with a copy of the test record sent to Valley Water District.

Customers with a BACKFLOW ASSEMBLY:

Consider “Opting In” to our TESTING PROGRAM!

In 2018, the District created a program that allows customers with backflow devices that are required to have annual testing done to “OPT IN” and have the District coordinate with a contractor to perform the test at a significantly reduced rate of \$30 per device (most testers charge \$40-\$90 per device). It’s not too late to opt in if you haven’t yet, you can find the Backflow Testing Agreement on the District website at www.valleywaterdistrict.com under FORMS.



If you are already opted in...no need to worry about future testing. Every year between May and September, the District will automatically have the contractor, Randy Horne with Aqua Backflow Testing, perform the testing for each property that has opted in.

SOURCE WATER PROTECTION—What you can do to help:

- Ensure that your septic system is properly maintained.
- Use chemical fertilizers and pesticides sparingly, if at all.
- Don’t dump any hazardous waste on the ground or down the drain. This includes motor oil, pesticides, paint, household cleaners, medicines, etc.

Check the SWAP information for your water system:

The WA State Department of Health Office of Drinking Water has compiled Source Water Assessment Program (SWAP) data for all community water systems. An interactive map with data for your water system is available at: <https://fortress.wa.gov/doh/swap/index.html>.

KEY TABLE DEFINITIONS

Action Level (AL): The concentration of a contaminant which, when exceeded, triggers treatment or other requirements which a water system must follow.

Maximum Contaminant Level (MCL): The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to MCLGs as feasible using the best available treatment technology.

Maximum Contaminant Level Goal (MCLG): The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

Maximum Residual Disinfectant Level (MRDL): The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Maximum Residual Disinfectant Level Goal (MRDLG): The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

Minimum Reporting Level (MRL): Also known as the Method Reporting Limit: The smallest amount of a substance that can be reliably quantitated in sample.

NA: Not Applicable

Nephelometric Turbidity Unit (NTU): a standard to measure water clarity.

Not Detected (ND): This compound was analyzed and not detected at a level greater than or equal to the State Detection Reporting Level.

PPB = Parts per billion **PPM =** Parts per million **Ug/L =** Microgram per liter

µmhos/cm = The basic unit of measurement of conductivity. **mg/L =** milligrams per liter

Secondary Maximum Contaminant Level (SMCL): These standards are developed as guidelines to protect the aesthetic qualities of drinking water and are not health based.

State Detection Reporting Limit (SDRL): The minimum reportable detection of an analyte as established by DOH.

Treatment Technique (TT): A required process intended to reduce the level of a contaminant in drinking water.

Variations and Exemptions: State or EPA permission not to meet an MCL, an action level, or a treatment technique under certain conditions.

Information About Lead...

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. Valley Water District is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking.

If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline 1-800-426-4791 or online at www.epa.gov/safewater/lead.

Public Notice regarding EPA required Service Line Inventory:

An EPA ruling required every Public Water System to conduct an inventory of all public and private lines to determine if the system had any lead service lines. The District is in compliance with that rule and has submitted the findings that were available with no lead found in any of our systems, however there are many that are considered "Unknown".

See the District website at www.valleywaterdistrict.com and select the Service Line Inventory tab for more details and to see the Service Line Inventory by each system.

About Monitoring Waivers

Organic Chemicals Radioactive Contaminants

Drinking water sources are sampled and tested a minimum of every six to nine years for an array of organic chemicals including volatile organic chemicals (VOCs) and synthetic organic chemicals (SOCs), such as herbicides and pesticides. VOCs are byproducts of industrial processes and petroleum production and can also come from gas stations, urban stormwater runoff, and septic systems.

Sampling frequencies for these groups of organic chemicals can vary depending on where the water system is located, whether the source has been granted a monitoring waiver, and whether that have been past detections of any of these organic contaminants.

Monitoring waivers are granted by the DOH and are based on a source's susceptibility rating (risk of contamination), water quality history, and information gathered across the state.

If there were detections or organic contaminants obtained during the most recent round of compliance monitoring, they are shown in the water quality data tables.

Radioactive Contaminants

Drinking water sources are sampled and tested a minimum of every six years for radioactive contaminants (radium 228 and gross alpha).

These contaminants can be naturally occurring or the result of oil and gas production and mining activities.

If there were any detections obtained during the most recent round of compliance monitoring, they are shown in the water quality data tables.



Water Quality Data Table Introduction

Your water is tested for more than 150 contaminants for which state and federal standards have been set.

Tables 1 & 2 list all primary contaminants that were detected at or above the state detection reporting limit (SDRL), along with their respective MCLs. Primary MCLs (primary standards) protect public health by limiting the levels of these contaminants in drinking water.

Table 3 (if applicable) lists secondary contaminants of interest to many consumers, as well as any unregulated contaminant detections. Secondary contaminants can mainly affect the aesthetic properties of water (taste, odor, and appearance). Unregulated contaminants are those for which EPA has not established drinking water standards. The purpose of unregulated contaminant monitoring is to help EPA determine their occurrence in drinking water and potential need for future regulation.

Water Quality Testing Results for 2025 Valley Water System

Table 1: PRIMARY CONTAMINANTS:

Contaminants	Unit	MCLG	MCL	Your Water	Range		Sample Date	Violation?	Typical Source
					Low	High			
Disinfectants & Disinfection By-Products									
Trihalomethanes, Total	ppb	NA	80	3.54	NA	NA	2025	No	By-product of drinking water disinfection
Inorganic Contaminants									
Arsenic	ppb	0	10	7.4	NA	NA	2024	No	Erosion of natural deposits; runoff from orchards; runoff from glass and electronics production wastes.
Nitrate [measured as Nitrogen]	ppm	10	10	0.53	NA	NA	2024	No	Runoff from fertilizer use; leaching from septic tanks, sewage; erosion of natural deposits
Total Nitrate/Nitrite	ppm	10	10	0.53	NA	NA	2024	No	Leaching from human/animal waste and runoff from fertilizers

Table 2: LEAD AND COPPER TESTING (2024):

Samples are collected at customer kitchen or bathroom taps in 10 homes. The number of homes sampled is based on population served by the water system. This testing is done every three years and the most recent sample date is from 2024.

Contaminants	90% of taps sampled must be below AL	90% of taps sampled were at or below this level	MCLG	# of Samples Exceeding AL	Violation?	Typical Source
Inorganic Contaminants						
Copper (ppm)	1.3 AL	0.202	1.3	0 of 10	No	Corrosion of household plumbing systems; erosion of natural deposits
Lead (ppb)	15 AL	1.00	0	0 of 10	No	Corrosion of household plumbing systems; erosion of natural deposits

PFAS or "Forever Chemicals" Testing Information - Tested on 12/11/25 (NO DETECTIONS)

Many of you have likely seen the news articles or television news stories about the "Forever Chemicals" that may be in the Public Water Systems. The chemicals known as PFAS or PFOA have been detected in many water systems in Washington State. The EPA and Department of Health have established rules for testing and treatment.

The District is happy to announce that we have conducted testing for these contaminants in the Valley system and there was NO DETECTION found. We will continue to test as required by Department of Health and keep you informed of results in the future.

For additional information on PFAS and related contaminants please go to <https://doh.wa.gov/community-and-environment/contaminants/pfas>

SEE NEXT PAGE FOR Table 3: Secondary Contaminants

SEE LAST PAGE FOR TACOMA WATER QUALITY RESULTS (Other Source for this system)

2025 Water Quality Report Valley Water System

Table 3: SECONDARY CONTAMINANTS: The samples below were taken mainly to monitor the aesthetic qualities of your drinking water, such as color, taste, and odor.

Analytes	Results	MCL	EPA Regulated Secondary	State Regulated	Year Sampled	Typical Source
Iron (ppm)	0.13	0.3	Yes	No	2024	Iron is naturally occurring. As rainwater it infiltrates the soil and underlying geologic formations dissolves iron, causing it to seep into aquifers that serve as sources of groundwater for wells.
Manganese (ppm)	0.028	0.05	Yes	No	2024	Manganese is a naturally occurring mineral that is present in soils, rocks, and sediment. Manganese in your water can also stain your laundry and create a brownish-black or black stain on your toilet, shower, bathtub, or sink. Manganese can make your water look, smell, or taste bad.
Chloride (ppm)	5.8	250	Yes	No	2024	Chloride occurs naturally in groundwater but is found in greater concentrations where seawater and run-off from road salts (salts used to de-ice icy roads) can make their way into water sources.
Sulfate (ppm)	7	250	Yes	No	2024	Sulfate is one of the major dissolved components of rain. As water moves through soil and rock formations that contain sulfate minerals, some of the sulfate dissolves into the groundwater.
Sodium* (ppm)	11	NA	No	Yes	2024	In drinking water, sodium can occur naturally or be the result of road salt applications, water treatment chemicals or ion-exchange water softening units.
Hardness** (ppm)	70	NA	No	Yes	2024	As your water moves through soil and rock, it dissolves very small amounts of minerals and holds them in solution. Calcium and magnesium dissolved in water are the two most common minerals that make water "hard." The degree of hardness becomes greater as the calcium and magnesium content increases and is related to the concentration of multivalent cations dissolved in the water.
Conductivity (umhos/cm)	164.1	700	No	Yes	2024	Conductivity is a measure of water's capability to pass electrical flow. This ability is directly related to the concentration of ions in the water. These conductive ions come from dissolved salts and inorganic materials such as alkalis, chlorides, sulfides and carbonate compounds. Compounds that dissolve into ions are also known as electrolytes. The more ions that are present, the higher the conductivity of water. Likewise, the fewer ions that are in the water, the less conductive it is.
Turbidity (NTU)	1.33	NA	No	Yes	2024	Turbidity is a measure of the degree to which the water loses its transparency due to the presences of suspended particulates. The more total suspended solids in the water, the murkier it seems and the higher the turbidity. Turbidity is considered as a good measure of the quality of water.

*Sodium: The EPA recommends 20 ppm sodium as a level of concern for consumers who must restrict their dietary intake.

**Hardness: When reading hardness value, 0-75 ppm is considered "soft" water, 75-150 ppm "moderately hard", 150-300 ppm is "hard", and > 300 ppm is "very hard".

CITY OF TACOMA 2025 WATER QUALITY TABLE

Constituent	Highest Level Allowed (MCL)	Highest Level Detected	Ideal Goals (MCLG)	Range of Level Detected or # exceed AL	Regulation Met?	Potential sources of contaminant
REGULATED AT THE GROUNDWATER SOURCES						
Arsenic	10 ppb	1.7 ppb (2021)	0	0-1.7 ppb	Yes	Natural erosion
Nitrate	10 ppm	4.0 ppm (2025)	10 ppm	0-4.0 ppm	Yes	Agricultural uses, septic
Trichloroethylene	5 ppb	1.6 ppb (2025)	0	0-1.6 ppb	Yes	Industrial contamination
UNREGULATED AT THE GROUNDWATER SOURCES						
Chloroform	not regulated	1.3 ppb (2025)	not regulated	0-1.3 ppb Average 0.259 ppb	not regulated	Industrial contamination
REGULATED AT THE TREATMENT PLANT						
Fluoride	4 ppm	.96 ppm	4 ppm	.04 - .96 ppm	Yes	Treatment additive
Turbidity	1NTU	.036 NTU	not applicable	0.017-0.036 NTU	Yes	Soil erosion
REGULATED IN THE DISTRIBUTION SYSTEM						
Disinfection byproducts	Highest running annual average allowed	Our running annual average	MCLG	Range of level Detected	Regulation Met?	Potential sources of contaminant
Total Trihalomethane	80 ppb average	12.8 ppb average	not applicable	3.58-35.4 ppb	Yes	Disinfection interaction
Haloacetic Acid	60 ppb average	2.0 ppb average	not applicable	<1-4.55 ppb	Yes	Disinfection interaction
Bromate	10 ppb	0	0	0	Yes	Disinfection interaction
Chlorine Residual	4ppm	NA	4 (MRDLG)	0.27 - 1.66 ppm	Yes	Treatment additive
Total Coliform	< 5% positive	0.000%	0	0 of 2469 sites	Yes	Sampling technique
REGULATED AT THE CONSUMERS TAP						
Lead & Copper: sampled in 2025. Required once every 3 years	90% of taps sampled must be below action level	90% of taps sampled were at or below this level	MCLG	# of sites above the action level	Regulation Met?	Potential sources of contaminant
Lead	15 ppb (AL)	ND	0	0 of 51 sites	Yes	Household plumbing
Copper	1.3 ppm (AL)	ND	1.3 ppm	0 of 51 sites	Yes	Household plumbing

Definitions

- (MCL) Maximum Contaminant Level: The highest level of a contaminant that is allowed in drinking water. MCL's are set as close to the MCLG's as feasible using the best available technology.
- (MCLG) Maximum Contaminant Level Goal: The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLG's allow for a margin of safety.
- ppm = Part Per Million
- ppb = Part Per Billion
- NTU- Nephelometric Turbidity Unit is a standard to measure water clarity.
- AL- Action Level is the concentration which, if exceeded, triggers treatment or other requirements which a water system must follow. Action Levels are reported at the 90th percentile for homes at greatest risk.
- MRL - Minimum Reporting Level, also known as Method Reporting Limit: The smallest amount of a substance that can be reliably quantitated in a sample.
- ND = Not Detected- This compound was analyzed and not detected at a level greater than or equal to the State Detection Reporting Level.

City of Puyallup

WATER QUALITY TABLE 2025		MCL [MRDL]		MCLG {MRDLG}		Highest Level Detected		Range Low - High		Violation
Arsenic (ppb)	10	0	7.9	ND-7.9	N					N
Chlorine (ppm)	4	4	1.3	0.2-1.3	N					N
HAAs (ug/L) (stage 2)	60	N/A	ND	ND	N					N
HAAs (ug/L) (stage 2) *	60	N/A	21.56	4.46 - 21.56	N					N
Nitrate (ppm)	10	10	3.16	<0.2-3.16	N					N
TTHMs (ppb)	80	N/A	3.83	2.53 - 3.83	N					N
TTHMs (ppb) *	80	N/A	28.45	6.35-28.45	N					N
Copper (ppm)	AL 1.3 m/L	1.3 m/L	1.17	Above AL 0/35	N					N
Lead (ppb)	AL 0.015 mg/L	0.015 mg/L	90% <15ppb	Above AL 0/35	N					N
Bromodichloro-Methane (ppb)			1.67	1.11-1.67	N					N
Chlorodibromo-Methane (ppb)			2.90	1.61-2.90	N					N
Chloroform (ppb)			1.51	0.68-1.51	N					N
Chloroform (ppb) *			26.02	5.25-26.02	N					N
Sodium (ppm)			28	6.0-28.0	N					N
Barium	2 ppm	2 ppm	< 0.01 ppm	< 0.01 ppm	N					N
Chromium	100 ppb	100 ppb	< 7 ppb	< 7 ppb	N					N
Nickel	100 ppb	100 ppb	< 5 ppb	< 5 ppb	N					N
Per & Polyfluoroalkyl Substances	UCMR 5	Results ng/L	SDRL	State Action Level ng/L	N					N
(PFBS) Perfluorobutanesulfonic acid	533/537.1	4.4 parts/trillion	3 parts/trillion	345 parts/trillion	N					N
(PFOS) Perfluorooctanesulfonic acid		2.9 parts/trillion	2 parts/trillion	15 parts/trillion	N					N
(PFHxA) Perfluorohexanoic acid		2.8 parts/trillion	2 parts/trillion	N/A	N					N
(PFOA) Perfluorooctanoic acid		3.3 parts/trillion	2 parts/trillion	10 parts/trillion	N					N
(PFHxS) Perfluorohexanesulfonic acid		2.1 parts/trillion	2 parts/trillion	65 parts/trillion	N					N
Disinfection By-Products		SYSTEM AVERAGE	HIGHEST SITES	RANGE ALL SITES	# of SITES					
LRAAs Puyallup	TTHMs	0.00337	0.00383	0.00253 - 0.00383	1					1
Localational running annual average	HAA55	ND	ND	ND	1					1
LRAAs Tacoma	TTHMs	0.02051	0.02845	0.00635 - 0.02845	1					1
Localational running annual average	HAA55	0.01167	0.02156	0.00446 - 0.02156	1					1

* City of Tacoma intertie